

# Group Number Assessment

(In accordance with AS 5637.1-2015)

Testing was performed in accordance with AS/NZS 3837-1998 Method of test for heat and smoke release rates for materials and products using an oxygen consumption calorimeter.

As per AS 5637.1 Clause 9(n) it was valid to test this particular material / system in the cone calorimeter for the assignment of a NCC Group Number.

---


**Test Sponsor :** Sketch Australia Pty Ltd  
10/1050 Thompsons Road  
Cranbourne West VIC 3977

**Test Number :** 23-003447  
**Issue Date :** 12/09/2023  
**Print Date :** 14/09/2023

---

**Sponsor Product :** Clients Ref : "Flexible Stone Veneer/Fire Rated  
Stone Veneer sample  
Sample A - Face  
Colour : Wall Covering  
End Use : Wall Covering  
Nominal Composition : Top Layer: 100% Metaphoric Stone  
Nominal Thickness : 2-3mm

---

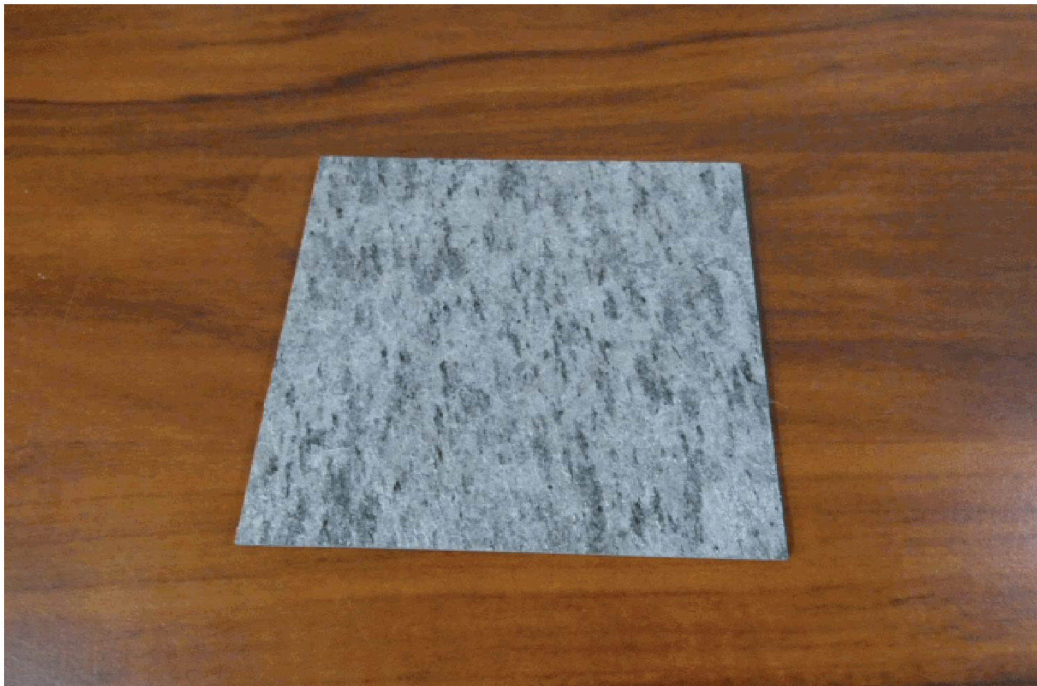

66404

---

The message/document(s) contained in this electronic attachment is intended for the party to which it is addressed and may contain confidential information or be subject to professional privilege. It's transmission is not intended to place the contents into the public domain.

If you have received this transmission in error, it's disclosure or copying is prohibited. Please contact us by collect call so that arrangements can be made at our expense to rectify the error.

---

# Group Number Assessment

(In accordance with AS 5637.1-2015)

Testing was performed in accordance with AS/NZS 3837-1998 Method of test for heat and smoke release rates for materials and products using an oxygen consumption calorimeter.

As per AS 5637.1 Clause 9(n) it was valid to test this particular material / system in the cone calorimeter for the assignment of a NCC Group Number.

---

**Test Sponsor :** Sketch Australia Pty Ltd  
10/1050 Thompsons Road  
Cranbourne West VIC 3977

**Test Number :** 23-003447  
**Issue Date :** 12/09/2023  
**Print Date :** 14/09/2023

---

Product Group Number Classification : 3

Average Specific Extinction Area : 326.4 m<sup>2</sup>/kg



Chris Campbell  
Client Relations Manager

66404

---

The message/document(s) contained in this electronic attachment is intended for the party to which it is addressed and may contain confidential information or be subject to professional privilege. It's transmission is not intended to place the contents into the public domain.

If you have received this transmission in error, it's disclosure or copying is prohibited. Please contact us by collect call so that arrangements can be made at our expense to rectify the error.